BOULDER CITY COUNTY HEALTH DEPARTMENT

3450 Broadway
Boulder, Colorado
Telephone 444-3250

Room 219
Woolworth Building
Longmont, Colorado
Telephone 776-5743

SPECIAL ENVIRONMENTAL HEALTH REPORT

Name of Establishment Allied Chemical

Address 63rd & Valmont Type of Establishment Chemical

PERSON INTERVIEWED Mr. Eckels Telephone Number

Purpose of Visit WATER INSPECTION

W N E

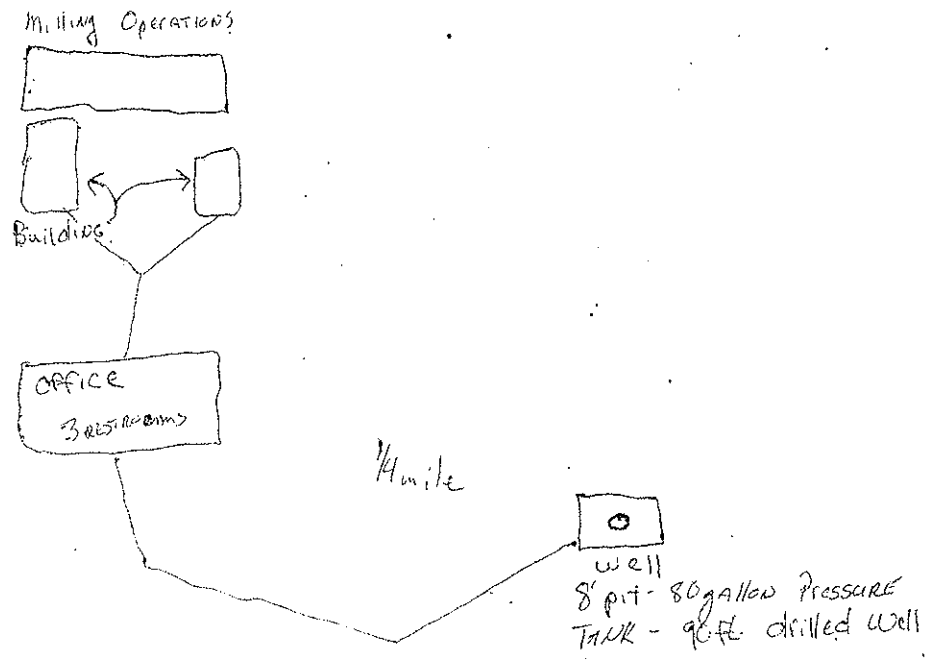

WATER IS hauled in by H&A bottle WATER. The employee's do not Drink The WATER. The only WATER Fountain From the well IS turned off and disconnected. The well IS NOT CONNECTED IN ANY MANNER to the milling OPERATIONS. The milling OPERATIONS ARE served by pond WATER. There are no cross-connections between these two WATER SYSTEMS. The well WATER IS NOT chlorinated.

Date 4-30-75 Owner or Representative

Sanitarian Stephen C Sadler